


Executive Order G-70-175

**Figure 2B-3
Control Panel**

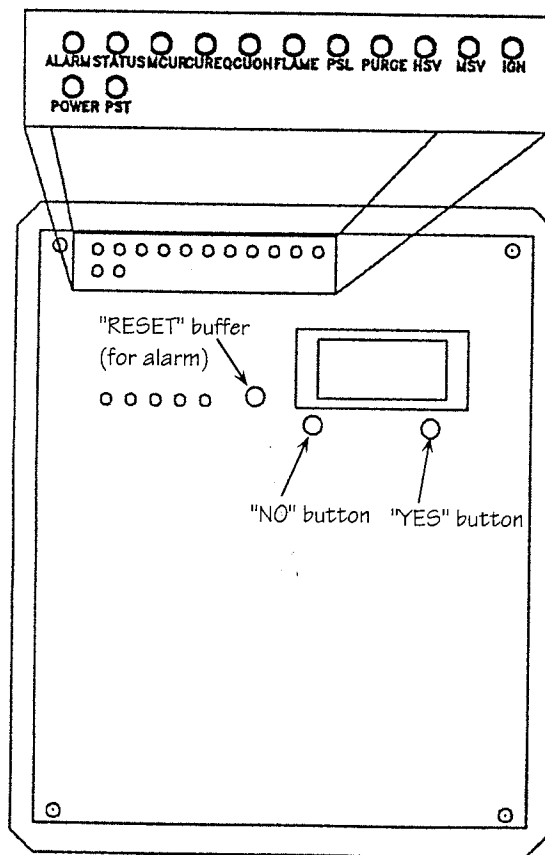

Key to LEDs:

ALARM => Alarm Condition
CUON => Collection Unit Active
CUREQ => Dispenser Active
FLAME => Processing Vapors
HSV => High Volume Processing
IGN => Initiate Processing
MCUR => Collection Unit Sensor
MSV => Main Processor Valve Open
POWER => Panel Power
PSL => Processor Pressure
PST => Tank Ullage Pressure
PURGE => Clearing Lines
STATUS => Not Used